



## PSI $\psi$ Calculation Report

Junction Name: E-10 90mm Celotex CW 21 x 140/100/100 Mineral wool  
Project Name: Standard Junctions

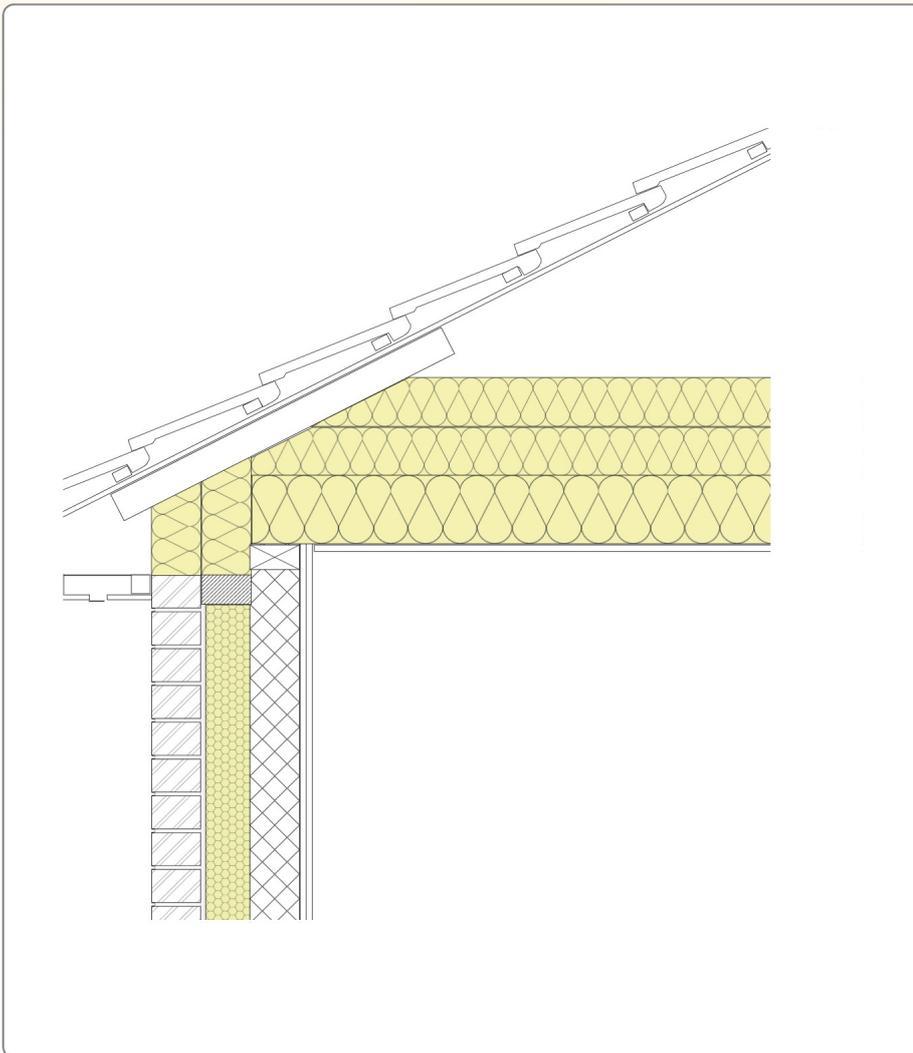

Psi  $\psi$ :  
**0.051**  
W/mK

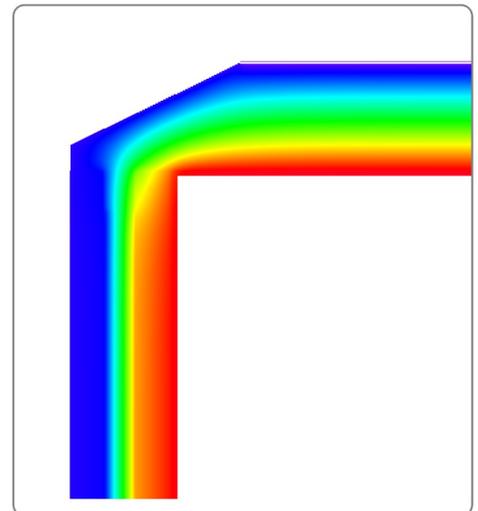

Nr.	Description	Length	Value	Correction factor
U1	U value 1	1.059 m	0.101 W/(m <sup>2</sup> K)	F <sub>e</sub> (1.00)
U2	U value 2	1.000 m	0.177 W/(m <sup>2</sup> K)	F <sub>e</sub> (1.00)

## Boundary conditions and Flow of heat

Nr.	Temp	Rsi/Rse	Length	Flow of heat
R1	0 C	0.1	0.332 m	-0.1312 W/m
R2	0 C	0.04	1.363 m	-4.1623 W/m
R3	0 C	0.1	1.214 m	8.4993 W/m
R4	20 C	0.1	1.0585 m	2.6211 W/m
R5	20 C	0.13	1.002 m	4.0681 W/m
R6	0 C	0.04	0.0823 m	-0.053 W/m

## Materials List

Description	Thickness (m)	Lambda
Plasterboard	0.013, 0.013	0.21
Insulation (generic)	0.100, 0.100, 0.140, 0.100, 0.100	0.035
Brick outer leaf	0.100	0.77
Concrete block (lightweight high strength)	0.100	0.15
Plaster Dabs	0.015	(R) 0.17
10mm Cavity	0.010	(R) 0.18
Celotex Cavity Wall 21	0.090	0.021

## Calculation of the thermal conductivity L2D

Conductance L2D : 0.335  
 Psi-value : 0.051 W/(mK)  
 fRsi-value : 0.939